

Test Report No. 7191001669-EEC11/01-YKF
dated 10 MAY 2011



PSB Singapore

Note: This report is issued subject to TÜV SÜD PSB's "Terms and Conditions Governing Technical Services".
The terms and conditions governing the issue of this report are set out as attached within this report.

**Choose certainty.
Add value.**

Subject

TYPE TESTING OF 13A SWITCHED AND UNSWITCHED SOCKET OUTLETS


Client

Legrand (S) Pte Ltd
15 Jalan Kilang Barat, #07-05,
Frontech Centre,
Singapore 159357

Attn: Mr. Chris Kok

Sample Submission Date

07 Mar 2011

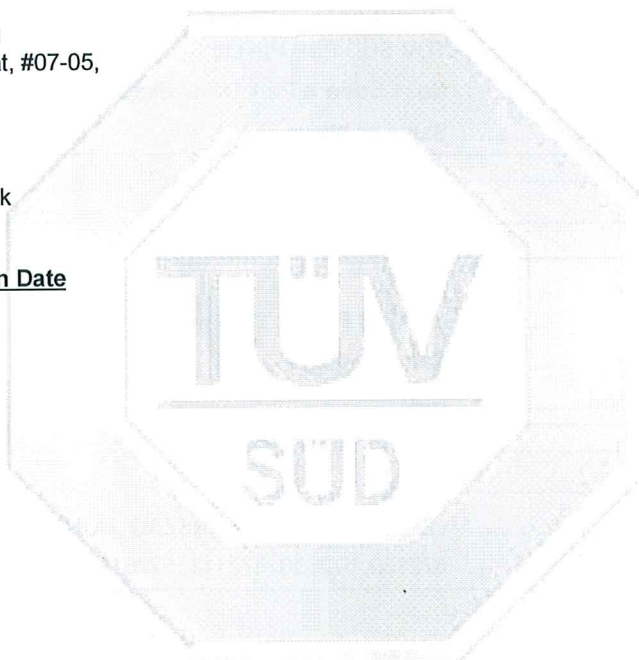

Laboratory:
TÜV SÜD PSB Pte. Ltd.
No.1 Science Park Drive
Singapore 118221

Phone : +65-6885 1333
Fax : +65-6776 8670
E-mail: testing@tuv-sud-psb.sg
www.tuv-sud-psb.sg
Co. Reg : 199002667R

Regional Head Office:
TÜV SÜD Asia Pacific Pte. Ltd.
3 Science Park Drive, #04-01/05
The Franklin, Singapore 118223
TUV®

		<p>LA-2007-0380-A LA-2007-0380-A-1 LA-2007-0381-F LA-2007-0382-B LA-2007-0383-G LA-2007-0384-G LA-2007-0385-E LA-2007-0386-C</p>	<p>The results reported herein have been performed in accordance with the laboratory's terms of accreditation under the Singapore Accreditation Council - Singapore Laboratory Accreditation Scheme. Tests/Calibrations marked "Not SAC-SINGLAS Accredited" in this Report are not included in the SAC-SINGLAS Accreditation Schedule for our laboratory.</p>
--	--	--	---



Ref. Certif. No.

HU-001259-A1

IEC SYSTEM FOR MUTUAL RECOGNITION OF TEST CERTIFICATES FOR ELECTRICAL EQUIPMENT (IECEE) CB SCHEME

SYSTEME CEI D'ACCEPTATION MUTUELLE DE CERTIFICATS D'ESSAIS DES EQUIPEMENTS ELECTRIQUES (IECEE) METHODE OC

CB TEST CERTIFICATE**CERTIFICAT D'ESSAI OC**Product
Produit

Socket-outlets

Name and address of the applicant
Nom et adresse du demandeurLegrand Magyarország Villamossági Rendszerek Zrt.
Ipartelepi út 14.
H-6600 Szentes, HungaryName and address of the manufacturer
Nom et adresse du fabricantLegrand Magyarország Villamossági Rendszerek Zrt.
Ipartelepi út 14.
H-6600 Szentes, HungaryName and address of the factory
Nom et adresse de l'usineLegrand Magyarország Villamossági Rendszerek Zrt.
Ipartelepi út 14.
H-6600 Szentes, HungaryNote: When more than one factory, please report on page 2
Note: Lorsque il y plus d'une usine, veuillez utiliser la 2^{ème} pageRatings and principal characteristics
Valeurs nominales et caractéristiques principales250V~, 16A;
Standards Sheet: IEC 60083:1975 St. Sh. C2a;
with side-earthing contact; rewirable;Trademark (if any)
Marque de fabrique (si elle existe)

legrand


Type of Manufacturer's Testing Laboratories used
Type de programme du laboratoire d'essais constructeur

Model / Type Ref.
Ref. De typeDesign: „ARTEOR”
(See page 2 of this Certificate for further details)Additional information (if necessary may also be reported on page 2)
Les informations complémentaires (si nécessaire, peuvent être indiqués sur la 2^{ème} pageThis Certificate is amendment No.1 to CBTC ref. No. HU-001259, dated 2014-02-18 and is issued to add new design name and new type reference numbers
(See details in Test Report)A sample of the product was tested and found to be in conformity with
Un échantillon de ce produit a été essayé et a été considéré conforme à la

IEC 60884-1:2002 (ed. 3) + A1 + A2

As shown in the Test Report Ref. No. which forms part of this Certificate
Comme indiqué dans le Rapport d'essais numéro de référence qui constitue partie de ce Certificat

28220817 003

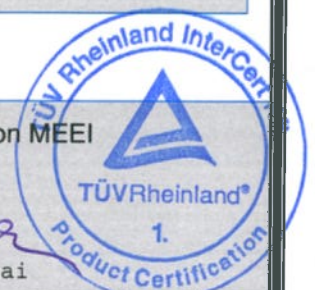This CB Test Certificate is issued by the National Certification Body
Ce Certificat d'essai OC est établi par l'Organisme National de CertificationTÜV Rheinland InterCert Kft., Division MEEI
H-1132 Budapest, Váci út 48/A-B
www.tuv.hu

Date: 2014-07-07

Signature:

Gabor Kassai

Model variants:

Ref. nr.	Description	Colour
572618	2P+E Socket outlet screw terminal with side-earthing contact with shutter	magnesium
572462	2P+E Socket outlet screw terminal with side-earthing contact with shutter	green
572460	2P+E Socket outlet screw terminal with side-earthing contact with shutter	orange
572118	2P+E Socket outlet screw terminal with side-earthing contact with shutter	white
572119	2P+E Socket outlet screw terminal with side-earthing contact and lid without shutter	white
572619	2P+E Socket outlet screw terminal with side-earthing contact and lid without shutter	magnesium
Accessories:		
Ref. nr.	Description	Colour
576021	support, 2 modules	-
576021E*	support, 2 modules (export)	-
576560	plate, 2 modules	white
576562	plate, 2 modules	graphite

* the „E” means that the product include the marking „Made in India”

Additional information (if necessary)
Information complémentaire (si nécessaire)



Date: 2014-07-07

TÜV Rheinland InterCert Kft., Division MEEI
H-1132 Budapest, Váci út 48/A-B
www.tuv.hu

Signature:

Gabor Kassai
Gabor Kassai





CERTIFICATE



Certificate No. PCS 00466.01

SUCOFINDO INTERNATIONAL CERTIFICATION SERVICES

Graha Sucofindo B1 Floor - Jl. Raya Pasar Minggu Kav. 34 Jakarta 12780
Phone : +62-21-7983666 ext. 1040; Fax :+62-21-7987015 / 7987029; Email : cs.sics@sucofindo.co.id


Menganugerahkan kepada

Hereby grants to

PT. LEGRAND INDONESIA

Setiabudi Building II Lt. 6 Suite 603

Jl. H. R. Rasuna Said Kav. 62, Kuningan. Jakarta 12920, Indonesia

Sertifikat Produk Penggunaan Tanda **SNI** dan 

Product Certificate for the Use of Marking on:

PRODUK : KOTAK-KONTAK UNTUK KEPERLUAN RUMAH TANGGA
(Product) *(Socket-Outlet for Household)*

TYPE / MODEL : Lihat Lampiran
(Type / Model) *(See Attachment)*

SPESIFIKASI : Lihat Lampiran
(Specification) *(See Attachment)*

MEREK : LEGRAND
(Brand)

PABRIK : LEGRAND ZRT
(Factory/ Production Site) 6600 Szentcs, Ipartelepi UT 14, Hungary

Telah memenuhi standar : **SNI 04-3892.1-2006**
(Comply with standard)

Sertifikat ini berdasarkan skema yang terdiri dari: Audit Pabrik, Pengujian Dan Pengawasan Berkala

This certificate is based on the scheme consists of: Factory Audit, Testing and Surveillance



Dr. Ir. Sufrin Hannan, M.M.

Ketua Badan Pelaksana
Chairman of Governing Board



This certificate is valid from August 14th, 2015 until August 13th, 2019

Sertifikat ini diberikan tunduk pada syarat-syarat pada "Product Certification Agreement"
This certificate is granted Subject to the provisions on "Product Certification Agreement"

01






Lampiran - sertifikat no. PCS 00466.01

(attachment to certificate no.)

No.	Model	Spesifikasi & Deskripsi <i>(specification & description)</i>
Arteor		
1	572118	2P+E Schuko Socket (CP) – 16A, 250 V – 2 modules - white
2	572119	2P+E Schuko Socket with cover (CP) – 16A, 250 V – 2 modules - white
3	572460	2P+E Schuko Socket (CP) – 16A, 250 V – 2 modules - orange
4	572462	2P+E Schuko Socket (CP) – 16A, 250 V – 2 modules - green
5	572618	2P+E Schuko Socket (CP) – 16A, 250 V – 2 modules – magnesium
6	572619	2P+E Schuko Socket (CP) – 16A, 250 V – 2 modules - magnesium
Niloe		
1	664747	2P+E Schuko Socket IP 44 with cover (CP) – 16A, 250 V – 2 modules - white
Plexo		
1	069576	2x 2P+E Prewired Schuko Socket IP 55 (CP) – 16A, 250 V – horizontal – grey
2	069577	2x 2P+E Prewired Schuko Socket IP 55 (CP) – 16A, 250 V – Vertical – grey
3	069578	3x 2P+E Prewired Schuko Socket IP 55 (CP) – 16A, 250 V – horizontal – grey





Ref. Certif. No.

HU-001259-A4/M1

IEC SYSTEM FOR MUTUAL RECOGNITION OF TEST CERTIFICATES FOR ELECTRICAL EQUIPMENT
(IECEE) CB SCHEME

CB TEST CERTIFICATE

Product

Socket-outlet

Name and address of the applicant

Legrand Magyarország Villamossági Rendszerek Zrt.
Ipartelepi út 14.
H-6600 Szentés, Hungary

Name and address of the manufacturer

Legrand Magyarország Villamossági Rendszerek Zrt.
Ipartelepi út 14.
H-6600 Szentés, Hungary

Name and address of the factory

Legrand Magyarország Villamossági Rendszerek Zrt.
Ipartelepi út 14.
H-6600 Szentés, Hungary

Note: When more than one factory, please report on page 2

Ratings and principal characteristics

250V~, 16A;
Standards Sheet: IEC 60083:1975 St. Sh. C2a;
with side-earthing contact; rewirable
(refer to Test Report for further details)

Trademark (if any))

Customer's Testing Facility (CTF) Stage used

Model / Type Ref.

Design: „Mosaic“ and „ARTEOR“
(See General product information of Test Report for
the list of type variants)Additional information (if necessary may also be
reported on page 2)This Certificate is modification No.1 to CBTC ref. No.
HU-001259, dated 2014-02-18 with amendments No. A1,
A2, A3, A4 and it is issued due to change of
construction
(See details in Test Report)A sample of the product was tested and found
to be in conformity with

IEC 60884-1:2002 + AMD1:2006 + AMD2:2013

As shown in the Test Report Ref. No. which forms part
of this Certificate

28220817 009

This CB Test Certificate is issued by the National Certification Body

TÜV Rheinland InterCert Kft., Division MEEI
H-1132 Budapest, Váci út 48/A-B
www.tuv.hu

Date: 2018-06-06

Signature:

Gabor Kassa



Ref. Certif. No.

FR 692865

IEC SYSTEM FOR MUTUAL RECOGNITION OF TEST
CERTIFICATES FOR ELECTRICAL EQUIPMENT
(IECEE) CB SCHEMESYSTEME CEI D'ACCEPTATION MUTUELLE DE
CERTIFICATS D'ESSAIS DES EQUIPEMENTS
ELECTRIQUES (IECEE) METHODE OC**CB TEST CERTIFICATE / CERTIFICAT D'ESSAI OC**Product
Produit

Fixed socket-outlet

Name and address of the applicant
Nom et adresse du demandeur**LEGRAND FRANCE**
128, avenue du Maréchal de Lattre de Tassigny, B.P. 523 - 87045 LIMOGES
CEDEX - FranceName and address of the manufacturer
Nom et adresse du fabricant**LEGRAND FRANCE**
128, avenue du Maréchal de Lattre de Tassigny B.P. 523 - 87045 LIMOGES
CEDEX - FranceName and address of the factory
Nom et adresse de l'usine

See annex 1

Note : When more than one factory, please report on page 2
Note : Lorsqu'il y a plus d'une usine, veuillez utiliser la 2ème pageRatings and principal characteristics
Valeurs nominales et caractéristiques principales

16 A, 250 V~

Trademark (if any)
Marque de fabrique (si elle existe)Type of Manufacturer's Testing Laboratories used
Type de programme du laboratoire d'essais constructeur


/

Model / Type Ref.
Ref. De typeSeries ARTEOR
Reference : 5 724 63Additional information (if necessary may also be
reported on page 2)
Informations complémentaires (si nécessaire, peuvent
être indiquées sur la 2ème page)See annex
Supersedes the CBTC n° 578318 dated 2009-03-19 : deletion of
references and update the standardA sample of the product was tested and found
to be in conformity with
Un échantillon de ce produit a été essayé et a été
considéré conforme à la**PUBLICATION****EDITION**

IEC 60884-1:2002(ed.3) +A1:2006 +A2:2013

As shown in the Test Report Ref. No. which forms part
of this Certificate
Comme indiqué dans le Rapport d'essais numéro de
référence qui constitue partie de ce Certificat

60052795-553453, 87010-578319, 144485-692510A, 144485-692510

This CB Test Certificate is issued by the National Certification Body
Ce Certificat d'essai OC est établi par l'Organisme **National de Certification****Laboratoire Central des Industries Électriques**33, av du Général Leclerc – BP 8
FR 92266 Fontenay-aux-Roses cedex
www.lcie.fr

Date:

2016-12-05

Signature:

Jean-François BRUEL

Annex 1 : List of Manufacturers and Factories

Fixed socket-outlet

Factory	Manufacturer
LEGRAND FRANCE 128, avenue du Maréchal de Lattre de Tassigny B.P. 523 - 87045 LIMOGES CEDEX - France	LEGRAND FRANCE 128, avenue du Maréchal de Lattre de Tassigny B.P. 523 - 87045 LIMOGES CEDEX - France
Novateur electrical & Digital of Sinnar Works Plot No, A-2, MIDC, Malegaon Village SINNAR, District : NASIK - 422113 SINNAR - India	LEGRAND FRANCE 128, avenue du Maréchal de Lattre de Tassigny B.P. 523 - 87045 LIMOGES CEDEX - France

Additional Information (if necessary)
Informations complémentaires (si nécessaire)



Laboratoire Central des Industries Électriques
33,av du Général Leclerc – BP 8
FR 92266 Fontenay-aux-Roses cedex
www.lcie.fr

Date: 2016-12-05

Signature: 
Certification Officer



Annex 2

MAIN CHARACTERISTICS

Standard sheet	III (CEE7)
Rated current	16 A
Rated voltage	250 V~
Degree of protection	IP20
Provision for earthing	with earthing contact
Method of connecting the cable	rewirable
Terminals	screw-type
Degree of protection against electric shock	normal protection
Existence of shutters	with shutters
Method of application - mounting	flush type
Method of installation	design A
Colour	red
Others	with tamperproof, square

Accessories

Frame	Cover plate		Designation
	White	Graphite	
5 760 21	5 765 60	5 762 62	2 modules

Additional Information (if necessary)
Informations complémentaires (si nécessaire)

**Laboratoire Central des Industries Électriques**

33, av du Général Leclerc – BP 8
FR 92266 Fontenay-aux-Roses cedex
www.lcie.fr



Date: 2016-12-05

Signature:

Jean-François BRUET
Certification Officer



Ref. Certif. No.

FR 692863

IEC SYSTEM FOR MUTUAL RECOGNITION OF TEST
CERTIFICATES FOR ELECTRICAL EQUIPMENT
(IECEE) CB SCHEMESYSTEME CEI D'ACCEPTATION MUTUELLE DE
CERTIFICATS D'ESSAIS DES EQUIPEMENTS
ELECTRIQUES (IECEE) METHODE OC**CB TEST CERTIFICATE / CERTIFICAT D'ESSAI OC**Product
Produit

Fixed socket-outlet

Name and address of the applicant
Nom et adresse du demandeur**LEGRAND FRANCE**128, avenue du Maréchal de Lattre de Tassigny, B.P. 523 - 87045 LIMOGES
CEDEX - FranceName and address of the manufacturer
Nom et adresse du fabricant**LEGRAND FRANCE**128, avenue du Maréchal de Lattre de Tassigny B.P. 523 - 87045 LIMOGES
CEDEX - FranceName and address of the factory
Nom et adresse de l'usine

See annex 1

Note : When more than one factory, please report on page 2
Note : Lorsqu'il y a plus d'une usine, veuillez utiliser la 2ème pageRatings and principal characteristics
Valeurs nominales et caractéristiques principales

15 A, 127 V~

Trademark (if any)
Marque de fabrique (si elle existe)Type of Manufacturer's Testing Laboratories used
Type de programme du laboratoire d'essais constructeur

/

Model / Type Ref.
Ref. De typeSeries ARTEOR
References see annex 2Additional information (if necessary may also be
reported on page 2)
Informations complémentaires (si nécessaire, peuvent
être indiquées sur la 2ème page)See annex 1
Supersedes the CBTC n° FR 649931 dated 2014-11-27 (addition of
references and factory)A sample of the product was tested and found
to be in conformity with
Un échantillon de ce produit a été essayé et a été
considéré conforme à la**PUBLICATION****EDITION**

IEC 60884-1:2002(ed.3) +A1:2006 +A2:2013

As shown in the Test Report Ref. No. which forms part
of this Certificate
Comme indiqué dans le Rapport d'essais numéro de
référence qui constitue partie de ce Certificat

144485-692864, LGB-09JA043ACSP, 124327-649933

This CB Test Certificate is issued by the National Certification Body
Ce Certificat d'essai OC est établi par l'Organisme **National de Certification****Laboratoire Central des Industries Électriques**33, av du Général Leclerc – BP 8
FR 92266 Fontenay-aux-Roses cedex
www.lcie.fr

Date:

2016-11-30

Signature:

Jean-François BRUEL
Certification Officer

Annex 1 : List of Manufacturers and Factories

Fixed socket-outlet

Factory	Manufacturer
LEGRAND BEIJING ELECTRICAL Co., Ltd N° 4 Chaoqian Road, Ke Ji Yuan Qu, Chang Ping District, 102200 BEIJING, China	LEGRAND FRANCE 128, avenue du Maréchal de Lattre de Tassigny B.P. 523 - 87045 LIMOGES CEDEX - France
Novateur electrical & Digital of Sinnar Works Plot No, A-2, MIDC, Malegaon Village SINNAR, District : NASIK - 422113 SINNAR - India	LEGRAND FRANCE 128, avenue du Maréchal de Lattre de Tassigny B.P. 523 - 87045 LIMOGES CEDEX - France

Additional Information (if necessary)
Informations complémentaires (si nécessaire)



Laboratoire Central des Industries Électriques
33,av du Général Leclerc – BP 8
FR 92266 Fontenay-aux-Roses cedex
www.lcie.fr

Date: 2016-11-30

Signature: Jean-François BRUEL
Certification Officer



Annex 2

RATING AND MAIN CHARACTERISTICS

Mechanism

References				Characteristics	Function	Specificities
Square						
Champagne	Soft alu	White	Magnesium			
/	/	5 721 05	5 726 05	15 A – 127 V~	2P polarized	1 module
5 700 40	5 710 40	5 721 17	5 726 17	15 A – 127 V~	2P+E	2 modules
5 700 47	5 710 47	5 721 34	5 726 34	15 A – 127 V~	2 x 2P+E	3 modules

Characteristics

Standard sheet	1-15 and 5-15 (NEMA WD6)
rated current	15A
rated voltage	127V~
degree of protection	IP20
provision for earthing	see table above
method of connecting the cable	rewirable
terminals	screw-type
degree of protection against electric shock	normal protection
Existence of shutters	without shutter
method of application - mounting	flush type
method of installation	design A

Accessories

Frame

Reference	Designation
5 760 01	3 modules 1 gang BS
5 760 40	3 modules US

Cover plate

Neutral		Frame	Designation
White	Graphite		
5 752 00	5 752 02	5 760 01	1 Module square BS
5 752 10	5 752 12	5 760 01	2 Modules square BS
5 751 60	5 751 62	5 760 01	3 Modules square BS
5 752 40	5 752 42	5 760 40	1 Module square US
5 752 50	5 752 52	5 760 40	2 Modules square US
5 752 70	5 752 72	5 760 40	3 Modules square US

Additional Information (if necessary)
Informations complémentaires (si nécessaire)



Laboratoire Central des Industries Électriques
33, av du Général Leclerc – BP 8
FR 92266 Fontenay-aux-Roses cedex
www.lcie.fr

Date: 2016-11-30

Signature:

Jean-François BRUEL
Certification Officer





Fair
Trading

Ref: NSW25352/2

RENEWAL OF CERTIFICATE OF APPROVAL: NSW25352

Particulars of Renewal

The approval of Socket Outlet, [auto-switched single general purpose outlet (AR787/15AMWE)], Model No. 572112 and all approved modifications has been renewed for a period of FIVE years.

The Approval expires on 30/06/2021 unless it is renewed, extended, suspended or cancelled.

For Commissioner for Fair Trading



Fair
Trading

Certificate Number: NSW25352

Certificate of Approval

ISSUED PURSUANT TO THE ELECTRICITY (CONSUMER SAFETY) ACT 2004

ISSUED TO: LEGRAND AUSTRALIA PTY LTD

CLASS OF ARTICLE: Socket Outlet

DESCRIPTION OF ARTICLE:

An auto-switched single General Purpose Outlet. (AR787/15AMWE)

Trade Name or Mark: LEGRAND

Volts: 240V AC

Amperes: 15

Watts:

Hertz: 50 Hz

Other Name Plate Particulars:

EXAMINED FOR COMPLIANCE WITH: AS/NZS 3100:2009 and AS/NZS 3112:2004 + A1

TYPE REFERENCE CODE: 572112


APPROVAL MARK:

Each electrical article of the type described above shall be marked with Approval Number NSW25352;

or the Regulatory Compliance Mark (RCM) provided that the requirements of all relevant parts of AS/NZS 4417 applicable to the article are fulfilled.

DATE OF APPROVAL: 30/06/2011

This approval expires 30/06/2016 unless suspended, cancelled, renewed or extended.


for Deputy Commissioner, Fair Trading Operations

ADDENDUM TO CERTIFICATE OF APPROVAL NSW25352

Particulars of Modification(s)

- 1) Modification model no 572612 is similar to original model no 572112 except for magnesium colour. (AR787/15AMMGN)
- 2) Modification model no 572114 is similar to original model no 572112 except for 10A rating. (AR787AMWE)
- 3) Modification model no 572614 is similar to modification model no 572612 except for 10A rating. (AR787AMMGN)
- 4) Modification model no 572126 is similar to modification model no 572114 except for round earth aperture. (AR787ARMWE)
- 5) Modification model no 572626 is similar to modification model no 572614 except for round earth aperture. (AR787ARMMGN)

Approved: 30 June 2011



for Deputy Commissioner, Fair Trading Operations



中国国家强制性产品认证证书

证书编号: 2016010201898929

委托人名称、地址

罗格朗(北京)电气有限公司
北京市昌平区科技园区超前路4号

生产者(制造商)名称、地址

罗格朗(北京)电气有限公司
北京市昌平区科技园区超前路4号

生产企业名称、地址

罗格朗(北京)电气有限公司
北京市昌平科技园区超前路4号

产品名称和系列、规格、型号

带保护门单相两极带接地暗装插座;带保护门单相两极带接地插座功能件(固定式插座用)

270030、270130、270230、280300、282700、283700 10A 250V~, 270032、
270132、270232、280100、280102、280302、282702、283702 16A 250V~;
280440、572113、572613 10A 250V~, 280442、572121、572621 16A 250V~

产品标准和技术要求

GB2099.1-2008; GB1002-2008

上述产品符合强制性产品认证实施规则
CNCA-C02-01: 2014的要求, 特发此证。

发证日期: 2016年09月19日 有效期至: 2021年09月19日

证书有效期内本证书的有效性依据发证机构的定期监督获得保持。

本证书的相关信息可通过国家认监委网站www.cnca.gov.cn查询



主任:

中国质量认证中心

中国·北京·南四环西路188号9区100070

<http://www.cqc.com.cn>



Q 1539277



CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

No. : 2016010201898929

NAME AND ADDRESS OF THE APPLICANT

Legrand (Beijing) Electrical Co., Ltd.
No.4 Chaoqian Road, Kejiyuanqu, Changping District, Beijing

NAME AND ADDRESS OF THE MANUFACTURER

Legrand (Beijing) Electrical Co., Ltd.
No.4 Chaoqian Road, Kejiyuanqu, Changping District, Beijing

NAME AND ADDRESS OF THE FACTORY

Legrand (Beijing) Electrical Co., Ltd.
No.4 Chaoqian Road, Kejiyuanqu, Changping District, Beijing

NAME, MODEL AND SPECIFICATION

Single-phase Flush-type Two-pole Socket-outlet with Earthing-contact with Shutter; Functional Module of Single-phase Two-pole Socket-outlet with Earthing-contact with Shutter

270030、270130、270230、280300、282700、283700 10A 250V~，270032、270132、270232、280100、280102、280302、282702、283702 16A 250V~；
280440、572113、572613 10A 250V~，280442、572121、572621 16A 250V~

THE STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS

GB2099.1-2008;GB1002-2008

This is to certify that the above mentioned products have met the requirements of implementation rules for compulsory certification (REF NO. CNCA-C02-01:2014).

Date of issue: Sep. 19, 2016 Date of expiry: Sep. 19, 2021

Validity of this certificate is subject to positive result of the regular follow up inspection by issuing certification body until the expiry date.

This certificate can be verified through CNCA's website: www.cnca.gov.cn



President:

Wang Kejiao

CHINA QUALITY CERTIFICATION CENTRE

Section 9, No.188, Nansihuan Xilu, Beijing 100070 P.R.China

<http://www.cqc.com.cn>



Q 1539277

IEC SYSTEM FOR MUTUAL RECOGNITION OF TEST CERTIFICATES FOR ELECTRICAL EQUIPMENT (IECEE) CB SCHEME

CB TEST CERTIFICATE

Product

Fixed socket-outlet

Name and address of the applicant

LEGRAND FRANCE
128 AVENUE DU MARECHAL DE LATTRE DE TASSIGNY
87045 LIMOGES CEDEX
FRANCE

Name and address of the manufacturer

LEGRAND FRANCE
128 AVENUE DU MARECHAL DE LATTRE DE TASSIGNY
87045 LIMOGES CEDEX
FRANCE

Name and address of the factory

See Annex

Note: When more than one factory, please report on page 2

 Additional Information on page 2

Ratings and principal characteristics

See Annex

Trademark (if any)



Customer's Testing Facility (CTF) Stage used

/

Model / Type Ref.

Series : ARTEOR
References : See Annex

Additional information (if necessary may also be reported on page 2)

Supersedes CBTC FR_705030 dated 20/02/2019. Editorial correction

 Additional Information on page 2


A sample of the product was tested and found to be in conformity with

IEC 60884-1:2002(ed.3) +A1:2006 +A2:2013

As shown in the Test Report Ref. No. which forms part of this Certificate

154281-718093, 60048013-548589, 87008-578303

This CB Test Certificate is issued by the National Certification Body

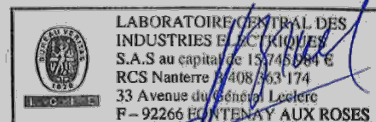LCIE – Laboratoire Central des Industries Electriques
33, avenue du Général Leclerc – BP8
FR 92 266 Fontenay aux Roses Cedex
www.lcie.fr

Date: 22/03/2019

Signature: **Jean-François BRUEL**
Certification Officer



Ref. Certif. No.

FR_705030/A1

ANNEX

Name and address of the factories:

LEGRAND (BEIJING) ELECTRICAL Co Ltd
N° 4 CHAOQIAN ROAD, CHANGPING DISTRICT KEJIYUANQU
101214 BEIJING
CHINA


LEGRAND FRANCE
128 AVENUE DU MARECHAL DE LATTRE DE TASSIGNY
87045 LIMOGES CEDEX
FRANCE

LEGRAND MAGYARORSZAG VILLAMOSSAGI RENDSZEREK ZRT
IPARTELEPI UT 14 PF 10
6600 SZENTES
HUNGARY

NOVATEUR ELECTRICAL & DIGITAL SYSTEMS PRIVATE LTD
A-2, SINNAR - MALEGAON VILLAGE MIDC,
NASHIK PUNE ROAD, DIST : NASHIK,
STATE - MAHARASHTRA
INDIA - 422113



LCIE – Laboratoire Central des Industries Electriques
33, avenue du Général Leclerc – BP8
FR 92 266 Fontenay aux Roses Cedex
www.lcie.fr



Date: 22/03/2019

Signature: **Jean-François BRUEL**
Certification Officer

ANNEX (continued)

REFERENCES – MAIN CHARACTERISTICS

Mechanism

References					Characteristics	Function	specificities
Champagne	Soft alu	Square		Red			
		5 720 20	Magnesium	5 725 20	16A – 250V~	2P	
5 700 21	5 710 21	5 720 21		5 725 21	16A – 250V~	2P+E	
				5 724 66	16A – 250V~	2P+E	Tamperproof

Characteristics

standard sheet	I / V CEE7
Rated current (A)	16A
Rated voltage (V)	250V~
Degree of protection	IP20 / IP44 with cover plate 5 751 90
Provision of earthing	See table
Method of connecting the cable	rewirable
Type of terminals	screw type
Degree of protection against electric shock	Increased protection
existence of shutters	with shutter
Method of mounting	Flush type
Method of installation	design A


Accessories :

Blank

References	Désignation
5 723 41	1 module square
5 728 41	1 module square
5 700 60	1 module square
5 710 60	1 module square
5 723 42	2 modules square
5 728 42	2 modules square
5 700 61	2 modules square
5 710 61	2 modules square
5 723 43	3 modules square
5 728 43	3 modules square



LCIE – Laboratoire Central des Industries Electriques
33, avenue du Général Leclerc – BP8
FR 92 266 Fontenay aux Roses Cedex
www.lcie.fr



Signature: **Jean-François BRUEL**
Certification Officer

Date: 22/03/2019


ANNEX (continued)

Frame

References	Designation
Type BS	
5 760 03	2 modules 1 gang
5 760 01	3 modules 1 gang
5 760 02	3 modules 2 gang
5 760 00	2x2 modules 2 gang
Type French / German	
5 760 21	2 modules
5 760 20	2 modules with claws
5 760 11	4 modules
5 760 12	6 modules
5 760 22	2x6 modules
5 760 13	2 modules for rail DIN
5 760 15	1 module thin wall
5 760 16	2 modules thin wall
Type US / Italia	
5 760 40	3 modules
Type US	
5 760 30	2 modules
5 760 31	4 modules
5 760 32	2x3 modules



LCIE – Laboratoire Central des Industries Electriques
33, avenue du Général Leclerc – BP8
FR 92 266 Fontenay aux Roses Cedex
www.lcie.fr



Date: 22/03/2019

Signature: **Jean-François BRUEL**
Certification Officer


ANNEX (continued)

Cover plate
Type BS

Frame	Designation	Neutral							Tattoo	Signature	
		White	Pearl alu	Graphite	Soft alu	Champagne	Dark bronze	Magnesium	Edition 1	Woven Metal	Cube
5 760 03 / 5 760 01	2 modules square	5 752 10	5 752 11	5 752 12	5 713 02	5 713 22	5 713 32	5 713 12	5 761 28	5 761 27	5 714 02
5 760 00	2x2 modules square	5 750 80	5 750 81	5 750 82	5 713 04	5 713 24	5 713 34	5 713 14	5 761 48	5 761 47	
5 760 02	3 modules square	5 750 70	5 750 71	5 750 72					5 761 68	5 761 67	
5 760 01	3 modules square	5 751 60	5 751 61	5 751 62	5 713 03	5 713 23	5 713 33	5 713 13	5 761 88	5 761 87	5 714 03
5 760 03 / 5 760 01	1 gang blank	5 751 30	5 751 31	5 751 32	5 716 08	5 716 12	5 716 14	5 716 10			
5 760 02 / 5 760 00	2 gang blank	5 751 40	5 751 41	5 751 42	5 716 09	5 716 13	5 716 15	5 716 11			
	2 modules IP44	5 751 90									



LCIE – Laboratoire Central des Industries Electriques
33, avenue du Général Leclerc – BP8
FR 92 266 Fontenay aux Roses Cedex
www.lcie.fr



Date: 22/03/2019

Signature: **Jean-François BRUEL**
Certification Officer

ANNEX (continued)

Frame	Designation	Graphic		Brushed metal				Reflective metal		
		Casual	Formal	Gold brass	Stainless steel	Black	Pink champagne	Reflective Stainless steel	Reflective gold	Reflective black
5 760 03 / 5 760 01	2 modules square	5 761 21	5 761 22	5 761 20	5 752 16	5 713 42	5 713 52	5 713 62	5 713 72	5 713 82
5 760 00	2x2 modules square	5 761 41	5 761 42	5 761 40	5 750 86	5 713 44	5 713 54	5 713 64	5 713 74	5 713 84
5 760 02	3 modules square	5 761 61	5 761 62	5 761 60	5 750 76					
5 760 01	3 modules square	5 761 81	5 761 82	5 761 80	5 751 66	5 713 43	5 713 53	5 713 63	5 713 73	5 713 83


Frame	Designation	Leather		Mirror				Wood		
		Club	Galuchat	Mirror black	Mirror red	Mirror taupe	Mirror white	Wenge Style	Light Oak	Grey Aok
5 760 03 / 5 760 01	2 modules square	5 761 23	5 761 24	5 752 13	5 761 26	5 761 25	5 752 14	5 752 15	5 761 29	5 713 92
5 760 00	2x2 modules square	5 761 43	5 761 44	5 750 83	5 761 46	5 761 45	5 750 84	5 750 85	5 761 49	5 713 94
5 760 02	3 modules square	5 761 63	5 761 64	5 750 73	5 761 66	5 761 65	5 750 74	5 750 75	5 761 69	
5 760 01	3 modules square	5 761 83	5 761 84	5 751 63	5 761 86	5 761 85	5 751 64	5 751 65	5 761 89	5 713 93

Type French / German

Frame	Designation	Neutral							Tattoo	Signature	
		White	Pearl alu	Graphite	Soft alu	champagne	Dark bronze	Magnesium	Edition 1	Woven Metal	Cube
5 760 21 / 5 760 20	2 modules square	5 765 60	5 765 61	5 765 62	5 715 62	5 715 82	5 715 92	5 765 67	5 762 48	5 762 47	5 715 80
5 760 21	2x2 modules square	5 750 20	5 750 21	5 750 22	5 715 63	5 715 83	5 715 93	5 750 27	5 762 68	5 762 67	5 714 04
5 760 22	2x6 modules square	5 750 60	5 750 61	5 750 62	5 715 65	5 715 85	5 715 95	5 715 75			
5 760 21	3x2 modules square	5 750 50	5 750 51	5 750 52	5 715 64	5 715 84	5 715 94	5 750 57			
5 760 11	4 modules square	5 750 30	5 750 31	5 750 32	5 714 14	5 714 34	5 714 44	5 750 37	5 762 78	5 762 77	
5 760 12	6 modules square	5 750 40	5 750 41	5 750 42	5 714 15	5 714 35	5 714 45	5 750 47	5 762 88	5 762 87	



LCIE – Laboratoire Central des Industries Electriques
 33, avenue du Général Leclerc – BP8
 FR 92 266 Fontenay aux Roses Cedex
www.lcie.fr



Date: 22/03/2019

 Signature: **Jean-François BRUEL**
 Certification Officer

ANNEX (continued)

Frame	Designation	Graphic		Brushed metal				Reflective metal		
		Casual	Formal	Gold brass	Stainless steel	Black	Pink champagne	Reflective Stainless steel	Reflective gold	Reflective black
5 760 21 / 5 760 20	2 modules square	5 762 41	5 762 42	5 762 40	5 765 66	5 715 57	5 715 67	5 715 77	5 715 87	5 715 97
5 760 21	2x2 modules square	5 762 61	5 762 62	5 762 60	5 750 26	5 715 58	5 715 68	5 715 78	5 715 88	5 715 98
5 760 21	3x2 modules square				5 750 56	5 715 59	5 715 69	5 715 79	5 715 89	5 715 99
5 760 11	4 modules square	5 762 71	5 762 72	5 762 70	5 750 36	5 714 19	5 714 29	5 714 39	5 714 49	5 714 59
5 760 12	6 modules square	5 762 81	5 762 82	5 762 80	5 750 46	5 714 20	5 714 30	5 714 40	5 714 50	5 714 60


Frame	Designation	Leather		Mirror				Wood		
		Club	Galuchat	Mirror black	Mirror red	Mirror taupe	Mirror white	Wenge Style	Light Oak	Grey Aok
5 760 21 / 5 760 20	2 modules square	5 762 43	5 762 44	5 765 63	5 762 46	5 762 45	5 765 64	5 765 65	5 762 49	5 715 60
5 760 21	2x2 modules square	5 762 63	5 762 64	5 750 23	5 762 66	5 762 65	5 750 24	5 750 25	5 762 69	5 715 70
5 760 21	3x2 modules square			5 750 53			5 750 54			
5 760 11	4 modules square	5 762 73	5 762 74	5 750 33	5 762 76	5 762 75	5 750 34	5 750 35	5 762 79	5 714 69
5 760 12	6 modules square	5 762 83	5 762 84	5 750 43	5 762 86	5 762 85	5 750 44	5 750 45	5 762 89	5 714 70

Type US / Italia

Frame	Designation	Neutral							Tattoo	Signature	
		White	Pearl alu	Graphite	Soft alu	Champagne	Dark bronze	magnesium	Edition 1	Woven Metal	Cube
5 760 40	2 modules square Italia	5 752 30	5 752 31	5 752 32	5 714 12	5 714 32	5 714 42	5 752 37	5 764 38	5 764 37	5 714 77
5 760 30 / 5 760 40	2 modules square US	5 752 50	5 752 51	5 752 52	5 714 82	5 715 02	5 715 12	5 714 92			
5 760 31	2 modules square US	5 752 60	5 752 61	5 752 62	5 714 86	5 715 06	5 715 16	5 714 96	5 766 28	5 766 27	5 715 52
5 760 32	2x3 modules square US	5 753 00	5 753 01	5 753 02	5 714 88	5 715 08	5 715 18	5 714 98	5 766 78		
5 760 40	3 modules square Italia	5 750 10	5 750 11	5 750 12	5 714 13	5 714 33	5 714 43	5 750 17	5 764 58	5 764 57	
5 760 40	3 modules square US	5 752 70	5 752 71	5 752 72	5 714 83	5 715 03	5 715 13	5 714 93			
5 760 31	3 modules square US	5 752 80	5 752 81	5 752 82	5 714 87	5 715 07	5 715 17	5 714 97	5 766 48	5 766 47	5 715 53
5 760 31	4 modules square US	5 752 90	5 752 91	5 752 92	5 714 84	5 715 04	5 715 14	5 714 94	5 766 58		
5 760 30 / 5 760 40	blank 2"x4"	5 754 10	5 754 11	5 754 12	5 714 10	5 714 53	5 714 51	5 714 52			
5 760 31 / 5 760 32	blank 4"x4"	5 753 60	5 753 61	5 753 62							



LCIE – Laboratoire Central des Industries Electriques
 33, avenue du Général Leclerc – BP8
 FR 92 266 Fontenay aux Roses Cedex
www.lcie.fr



Date: 22/03/2019

 Signature: **Jean-François BRUEL**
 Certification Officer


ANNEX (continued)

Frame	Designation	Graphic		Brushed metal				Reflective metal		
		Casual	Formal	Gold brass	Stainless steel	Black	Pink champagne	Reflective Stainless steel	Reflective gold	Reflective black
5 760 40	2 modules square Italia	5 764 31	5 764 32	5 764 30	5 752 56	5 714 17	5 714 27	5 714 37	5 714 47	5 714 57
5 760 30 / 5 760 40	2 modules square US									
5 760 31	2 modules square US	5 766 21	5 766 22	5 766 20	5 752 66	5 715 22	5 715 27	5 715 32	5 715 37	5 715 42
5 760 32	2x3 modules square US	5 766 71	5 766 72	5 766 70	5 753 06	5 715 25	5 715 30	5 715 35	5 715 40	5 715 45
5 760 40	3 modules square Italia	5 764 51	5 764 52	5 764 50	5 752 76					
5 760 40	3 modules square US									
5 760 31	3 modules square US	5 766 41	5 766 42	5 766 40	5 752 86	5 715 23	5 715 28	5 715 33	5 715 38	5 715 43
5 760 31	4 modules square US	5 766 51	5 766 52		5 752 96	5 715 24	5 715 29	5 715 34	5 715 39	5 715 44

Frame	Designation	Leather		Mirror				Wood		
		Club	Galuchat	Mirror black	Mirror red	Mirror taupe	Mirror white	Wenge Style	Light Oak	Grey Aok
5 760 40	2 modules square Italia	5 764 33	5 764 34	5 752 53	5 764 36	5 764 35	5 752 54	5 752 55	5 764 39	5 714 67
5 760 30 / 5 760 40	2 modules square US									
5 760 31	2 modules square US	5 766 23	5 766 24	5 752 63	5 766 26	5 766 25	5 752 64	5 752 65	5 766 29	5 715 47
5 760 32	2x3 modules square US			5 753 03	5 766 76	5 766 75	5 753 04			
5 760 40	3 modules square Italia	5 764 53	7 764 54	5 752 73	5 764 56	5 764 55	5 752 74	5 752 75	5 764 59	
5 760 40	3 modules square US									
5 760 31	3 modules square US	5 766 43	5 766 44	5 752 83	5 766 46	5 766 45	5 752 84	5 752 85	5 766 49	5 715 48
5 760 31	4 modules square US			5 752 93	5 766 56	5 766 55	5 752 94			



LCIE – Laboratoire Central des Industries Electriques
33, avenue du Général Leclerc – BP8
FR 92 266 Fontenay aux Roses Cedex
www.lcie.fr



Signature: **Jean-François BRUEL**
Certification Officer

Date: 22/03/2019


ANNEX (continued)

Cover plate + frame
Type India

Designation	Neutral							Brushed metal		
	White	Pearl alu	Graphite	Soft alu	Champagne	Dark bronze	Magnesium	Stainless steel	black	Pink champagne
2 modules square	5 757 10	5 757 11	5 757 12					5 757 16		
2x4 modules square	5 757 60	5 757 61	5 757 62					5 757 66		
2x6 modules square	5 753 90	5 753 91	5 753 92	5 716 00	5 716 04	5 716 06	5 716 02	5 753 96		
	5 757 70	5 757 71	5 757 72					5 757 76		
2x8 modules square	5 757 80	5 757 81	5 757 82							
3 modules square	5 757 20	5 757 21	5 757 22					5 757 26		
3x6 modules square	5 754 00	5 754 01	5 754 02	5 716 01	5 716 05	5 716 07	5 716 03			
	5 757 90	5 757 91	5 757 92							
3x8 modules square	5 758 00	5 758 01	5 758 02							
4 modules square	5 757 30	5 757 31	5 757 32					5 757 36		
6 modules square	5 757 40	5 757 41	5 757 42					5 757 46		
6 modules square	5 753 70	5 753 71	5 753 72	5 713 06	5 713 26	5 713 36	5 713 16	5 753 76	5 713 46	5 713 56
8 modules square	5 757 50	5 757 51	5 757 52					5 757 56		
2 modules blank	5 758 10									



LCIE – Laboratoire Central des Industries Electriques
33, avenue du Général Leclerc – BP8
FR 92 266 Fontenay aux Roses Cedex
www.lcie.fr



Date: 22/03/2019


Signature: **Jean-François BRUEL**
Certification Officer

ANNEX (end)

Designation	Reflective metal			Mirror		Wood		Signature
	Reflective Stainless steel	Reflective gold	Reflective black	Mirror black	Mirror white	Wenge Style	Grey oak	Cube
2 modules square				5 757 13	5 757 14	5 757 15		
2x4 modules square				5 757 63	5 757 64			
2x6 modules square				5 757 73	5 757 74			
2x8 modules square								
3 modules square				5 757 23	5 757 24	5 757 25		
3x6 modules square								
3x8 modules square								
4 modules square				5 757 33	5 757 34	5 757 35		
6 modules square				5 757 43	5 757 44			
6 modules square	5 713 66	5 713 76	5 713 86	5 753 73	5 753 74	5 753 75	5 713 96	5 714 06
8 modules square				5 757 53	5 757 54			
2 modules blank								



LCIE – Laboratoire Central des Industries Electriques
33, avenue du Général Leclerc – BP8
FR 92 266 Fontenay aux Roses Cedex
www.lcie.fr



Signature: **Jean-François BRUEL**
Certification Officer

Date: 22/03/2019